

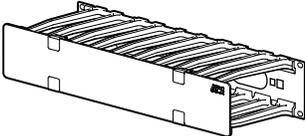
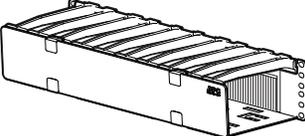
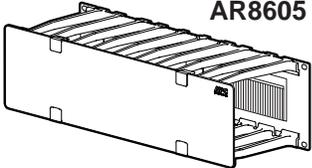


Horizontal Cable Managers — Installation


AR8612, AR8603A, AR8605, AR8606, AR8600A, AR8602A

Inventory


Horizontal Cable Managers

	6 Inch (152.4 mm) Deep	4 Inch (101.6 mm) Deep
1U	 <p>AR8612</p>	 <p>AR8602A</p>
2U	 <p>AR8606</p>  <p>AR8603A</p>	 <p>AR8600A</p>
3U	 <p>AR8605</p>	

Hardware

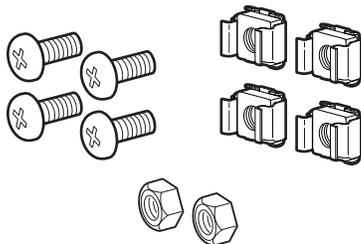

Tools required (not provided)

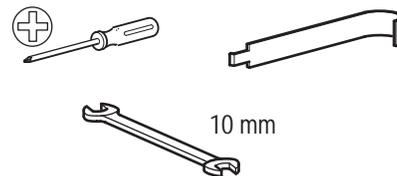


How to install and remove caged nuts

⚠ CAUTION

FALLING EQUIPMENT


To ensure equipment installs securely, install cage nuts with tabs engaging the left and right sides of the square hole. Do NOT install cage nuts with tabs engaging the top and bottom of the square hole.

Failure to follow these instructions can result in injury or equipment damage.

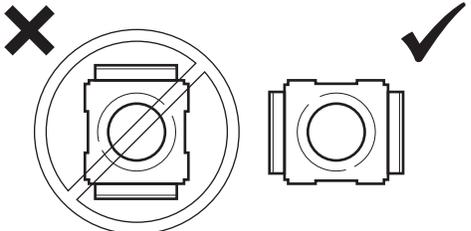

To install a cage nut:

1. From the inside of the enclosure insert the cage nut into the square hole by hooking a tab from one side of the cage nut onto one side of the opening.
2. Place the cage nut tool onto the tab on the opposite side of the cage nut and pull to snap it into position.

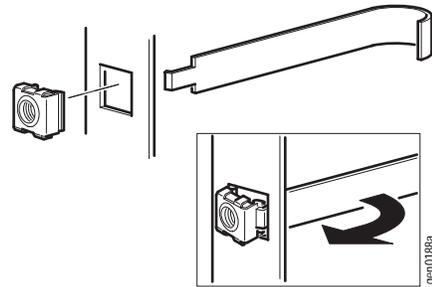


To remove a caged nut:

1. Squeeze the tabs together to release.


Installation

Adjust the vertical mounting rails


Adjust the depth of the vertical mounting rails, if needed, for non-networking enclosures.

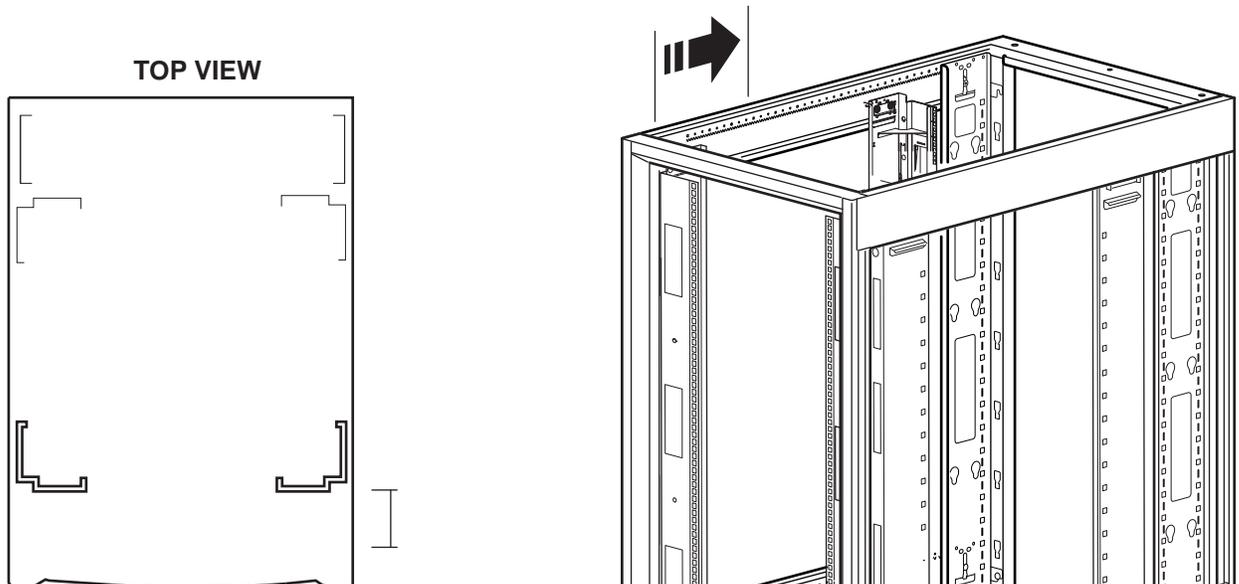


Install the Horizontal Cable Manager

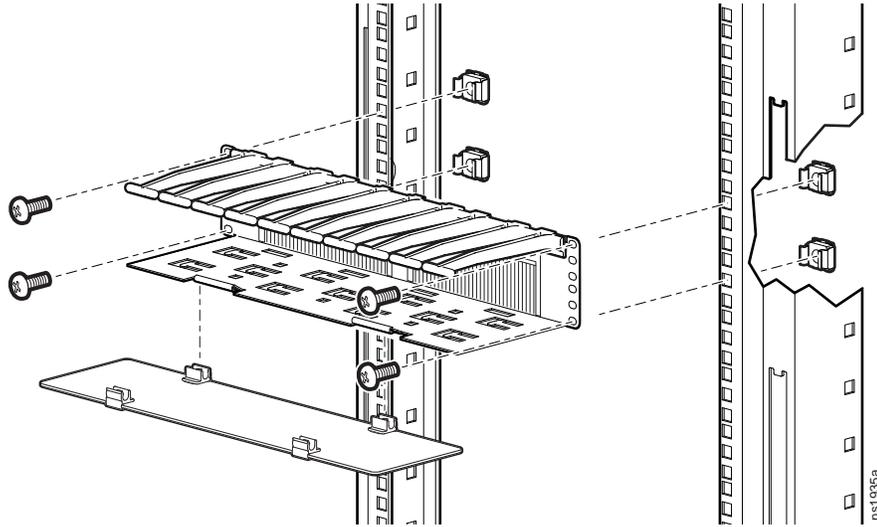


Installing back-to-back Horizontal Cable Managers

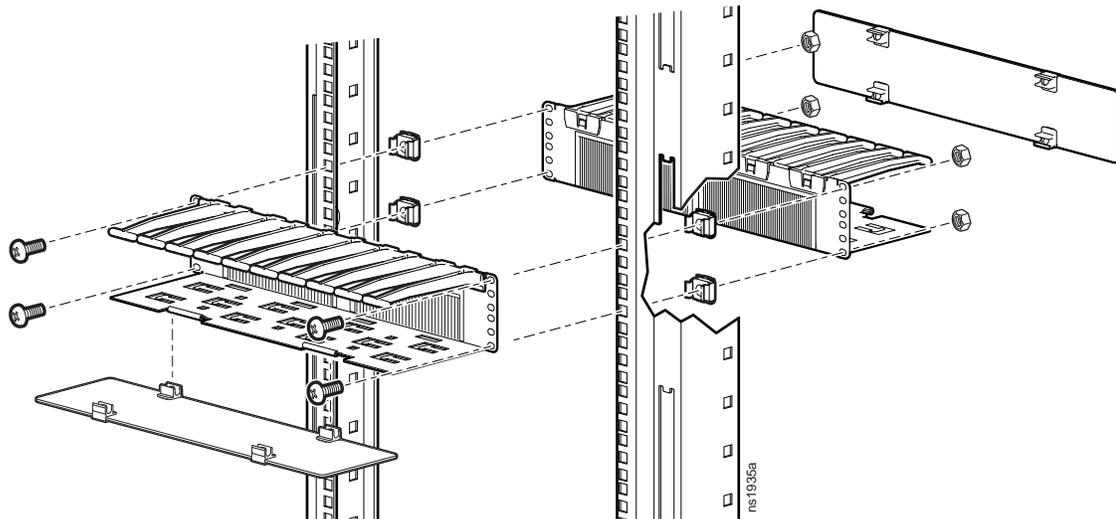


Cover Operation

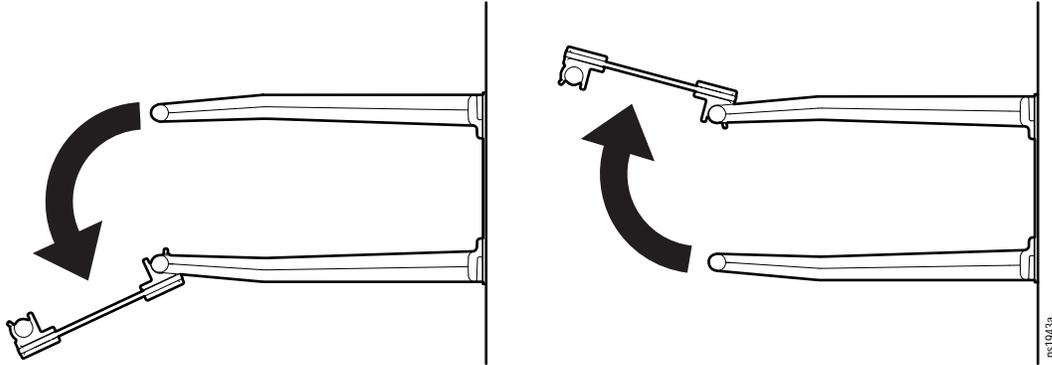

Accessories (not provided)



**Cable retainer
AR8621**

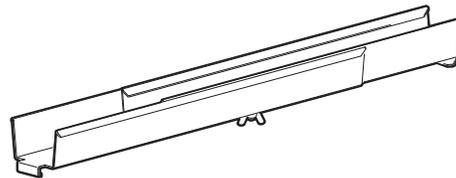

**Side channel cable trough
AR8016ABLK, AR8008BLK**

Customer support and warranty information is available at the APC Web site, www.apc.com.

© 2013 APC by Schneider Electric. All rights reserved. APC, the APC logo and all APC trademarks are property of Schneider Electric S.A.S. Other trademarks are property of their respective owners.

**990-4898-001
2/2013**